



GENERAL NOTES:
UNIT INSTALLS ON FINISH FLOOR. UNDERGROUND
WIRING CONDUIT REQUIRED.
OPTIONAL PLATFORM AVAILABLE.
FLOOR MUST BE DEAD LEVEL.

UNIT IS FREE STANDING - NO VERTICAL STRUCTURAL
SUPPORT REQUIRED.

ELECTRICAL NOTES:
POWER SERVICE REQUIRED:
110VAC OR 220VAC (1) PHASE 60HZ, 15A, NEUTRAL, GROUND.
AUTHORIZATION REQUIRES DRY CONTACT FROM ACCESS
CONTROL.

ALL CONDUIT BY OTHERS.

- CODED NOTES:**
1. CABINET - #4 STAINLESS STEEL. ALTERNATE P.C. COLORS AVAILABLE
 2. TOP - BLACK TEMPERED GLASS
 3. AUTHORIZATION LIGHT / CARD READER LOCATION
MAX CARD READER SIZE:
2.16" W X 5.11" L X 2.0" H OR METRIC [55mm] W X [130mm] L X [51mm] H
 4. FRONT COVER - BLACK TEMPERED GLASS

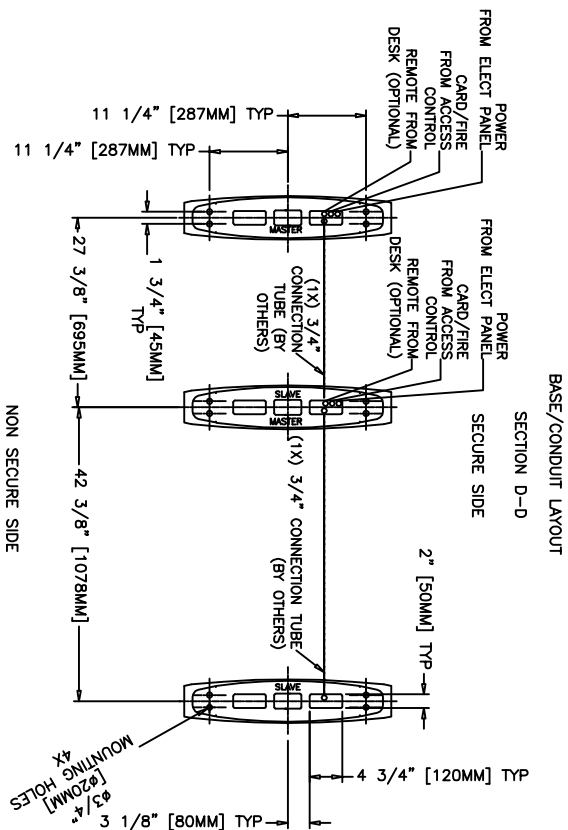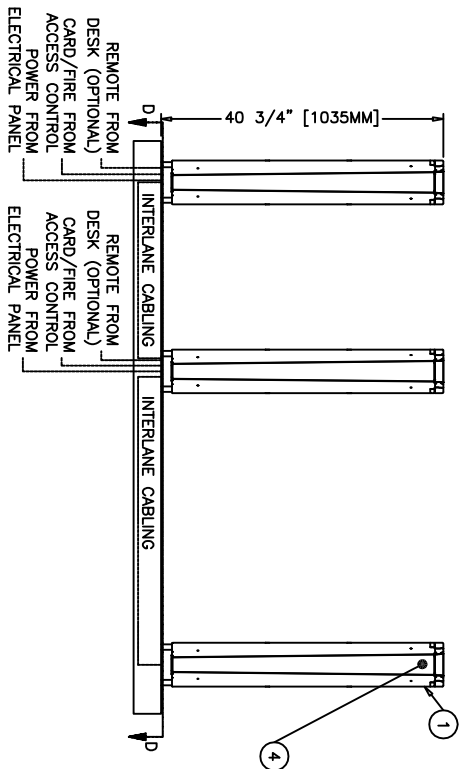

SPEEDLANE OPEN: 2 LANE - 1 STD 1 ADA

Project: -
Job #: -
Rev: A
Rev Date: 11/21/16

By: AA

Customer:
Contractor:
Architect:

Dwg #:

BOON EDAM

402 McKinney PKWY, Lillington, NC 27546 - (910) 814-3800 © BOON EDAM